



**Grant County**  
**Central Services**  
P O Box 37  
Ephrata WA 98823  
(509) 754-2011 Ext-3276

All perspective bidders  
Subj: Addendum #1CSD1913 Ardell Fire Suppression

June 19, 2019

The architect has sent out an addendum regarding page E1. It was discovered that there is a conduit feeding emergency lighting running along the wall in the area where the riser room is to be constructed.


The addendum noted as “AD1-E1” shows an updated electrical plan and added notes in this area. It reflects rerouting of the conduit around this room.

Respectfully,


*Tom Gaines*

Tom Gaines  
Director, Grant County WA  
Central Services Department

Tom Gaines  
Director of Central Services  
tgaines@grantcountywa.gov

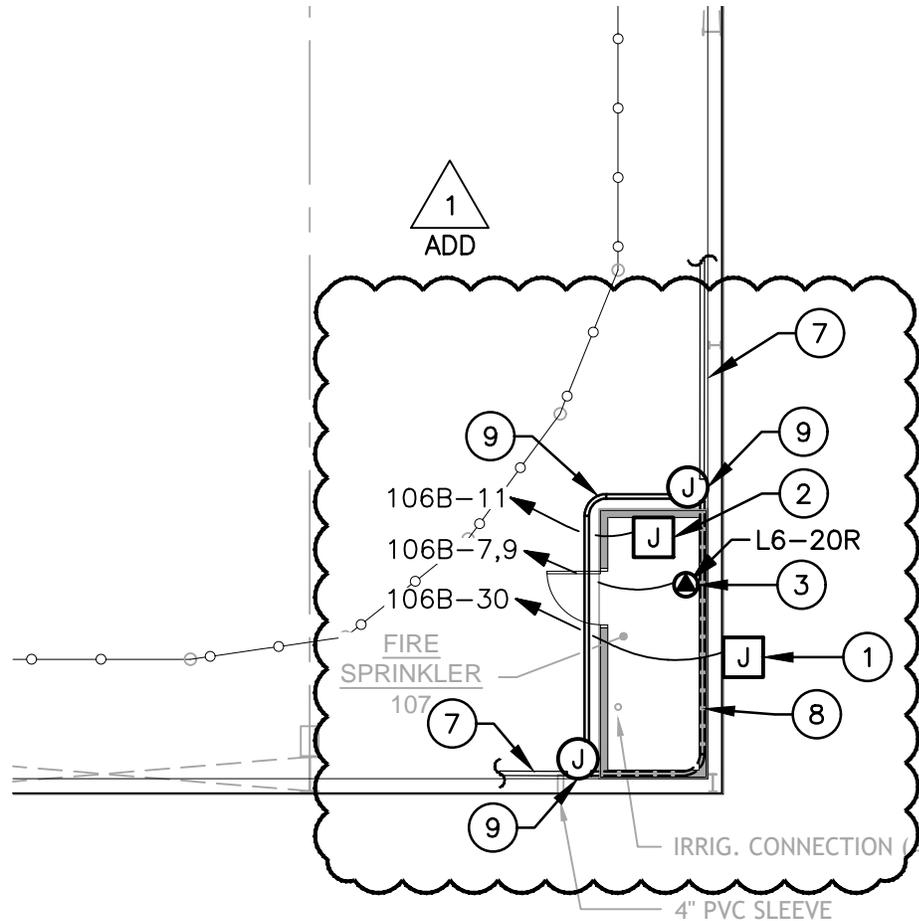

## KEYNOTES



7. EXISTING CONDUIT AND CONDUCTORS ROUTED ALONG EXISTING WALL.
8. REMOVE EXISTING CONDUIT AND CONDUCTORS WHICH ARE ROUTED THROUGH NEW FIRE SPRINKLER SPACE.
9. REROUTE CONDUIT AND CONDUCTORS, AT NEW FIRE SPRINKLER ROOM TO OUTSIDE OF NEW SPACE. MAINTAIN EXISTING CIRCUIT, EXTEND CONDUIT AND CONDUCTORS AS REQUIRED.